

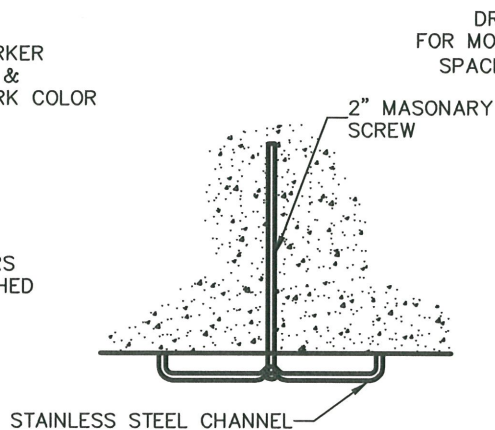
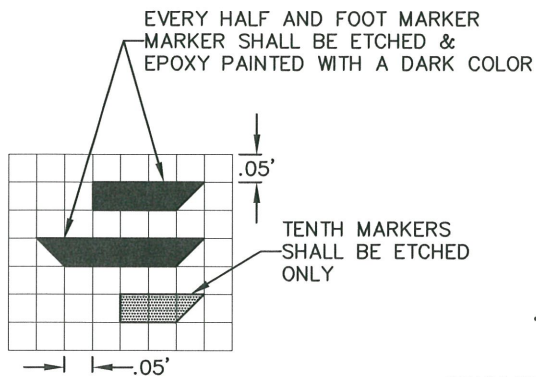






DISCLAIMER: this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.



SECTION A-A
NOT TO SCALE


TENTH MARKERS



ADJUSTMENT TABLE	
SLOPE OF WALL	MULTIPLIER
VERTICAL	1
1:1	1:4
2:1	2:2

DEMONSTRATIONS GIVEN ARE FOR VERTICAL. MULTIPLY BY VERTICAL DIMENSIONS BY FACTOR ABOVE FOR EXISTING CONDITIONS.

NOTE:
MATERIAL SHALL BE STAINLESS STEEL WITH NUMBERS & MARKINGS ETCHED. EPOXY PAINT NUMBERS, WHOLE & HALF FOOT MARKERS WITH CONTRASTING COLOR

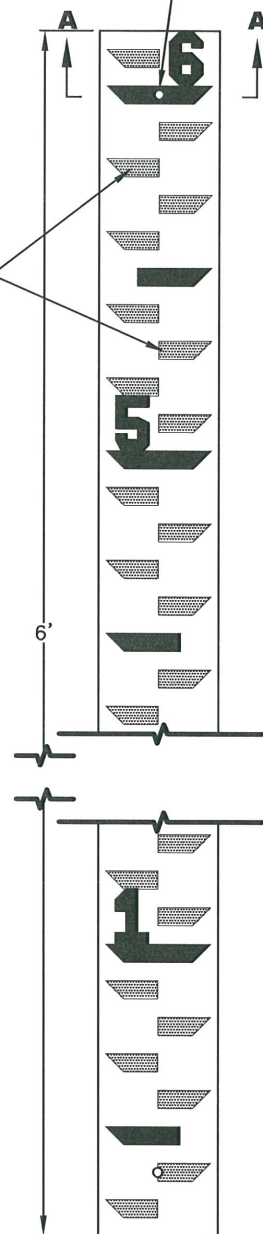

MOUNT GAUGE 2 TENTHS FOOT ABOVE FLOWLINE OF CHANNEL



SEPT 06

DATE DRAWN

6200-00

STANDARD DRAWING NO.

CITY OF WICHITA FALLS, TX

DEPTH GAUGE

APPROVED

Depth_Gauge.dwg

ACAD DRAWING NAME

NO.	DATE	DESCRIPTION	BY
R	E	V	I
S	I	O	N
S			

Scott Taylor
CITY ENGINEER

SEPT 2006
DATE